


# Competitive Renewable Energy Zones (CREZ) Transmission Optimization Study Figure 5: Scenario 2



- DOUBLE CIRCUIT 345KV TRANSMISSION LINE
- - - SINGLE CIRCUIT 345KV TRANSMISSION LINE
- ADDITION OF SECOND CIRCUIT TO THE EXISTING 345KV STRUCTURE
- - - SINGLE CIRCUIT 138KV TRANSMISSION LINE
- ADDITION OF SECOND CIRCUIT TO THE EXISTING 138KV STRUCTURE
- EXISTING 345KV SUBSTATION
- EXISTING 138KV SUBSTATION
- NEW 345KV SUBSTATION
- NEW 345KV SUBSTATION WITH 345/138KV AUTOTRANSFORMER
- WIND POWER COLLECTION POINT

SCALE: 1" = 25 MILES

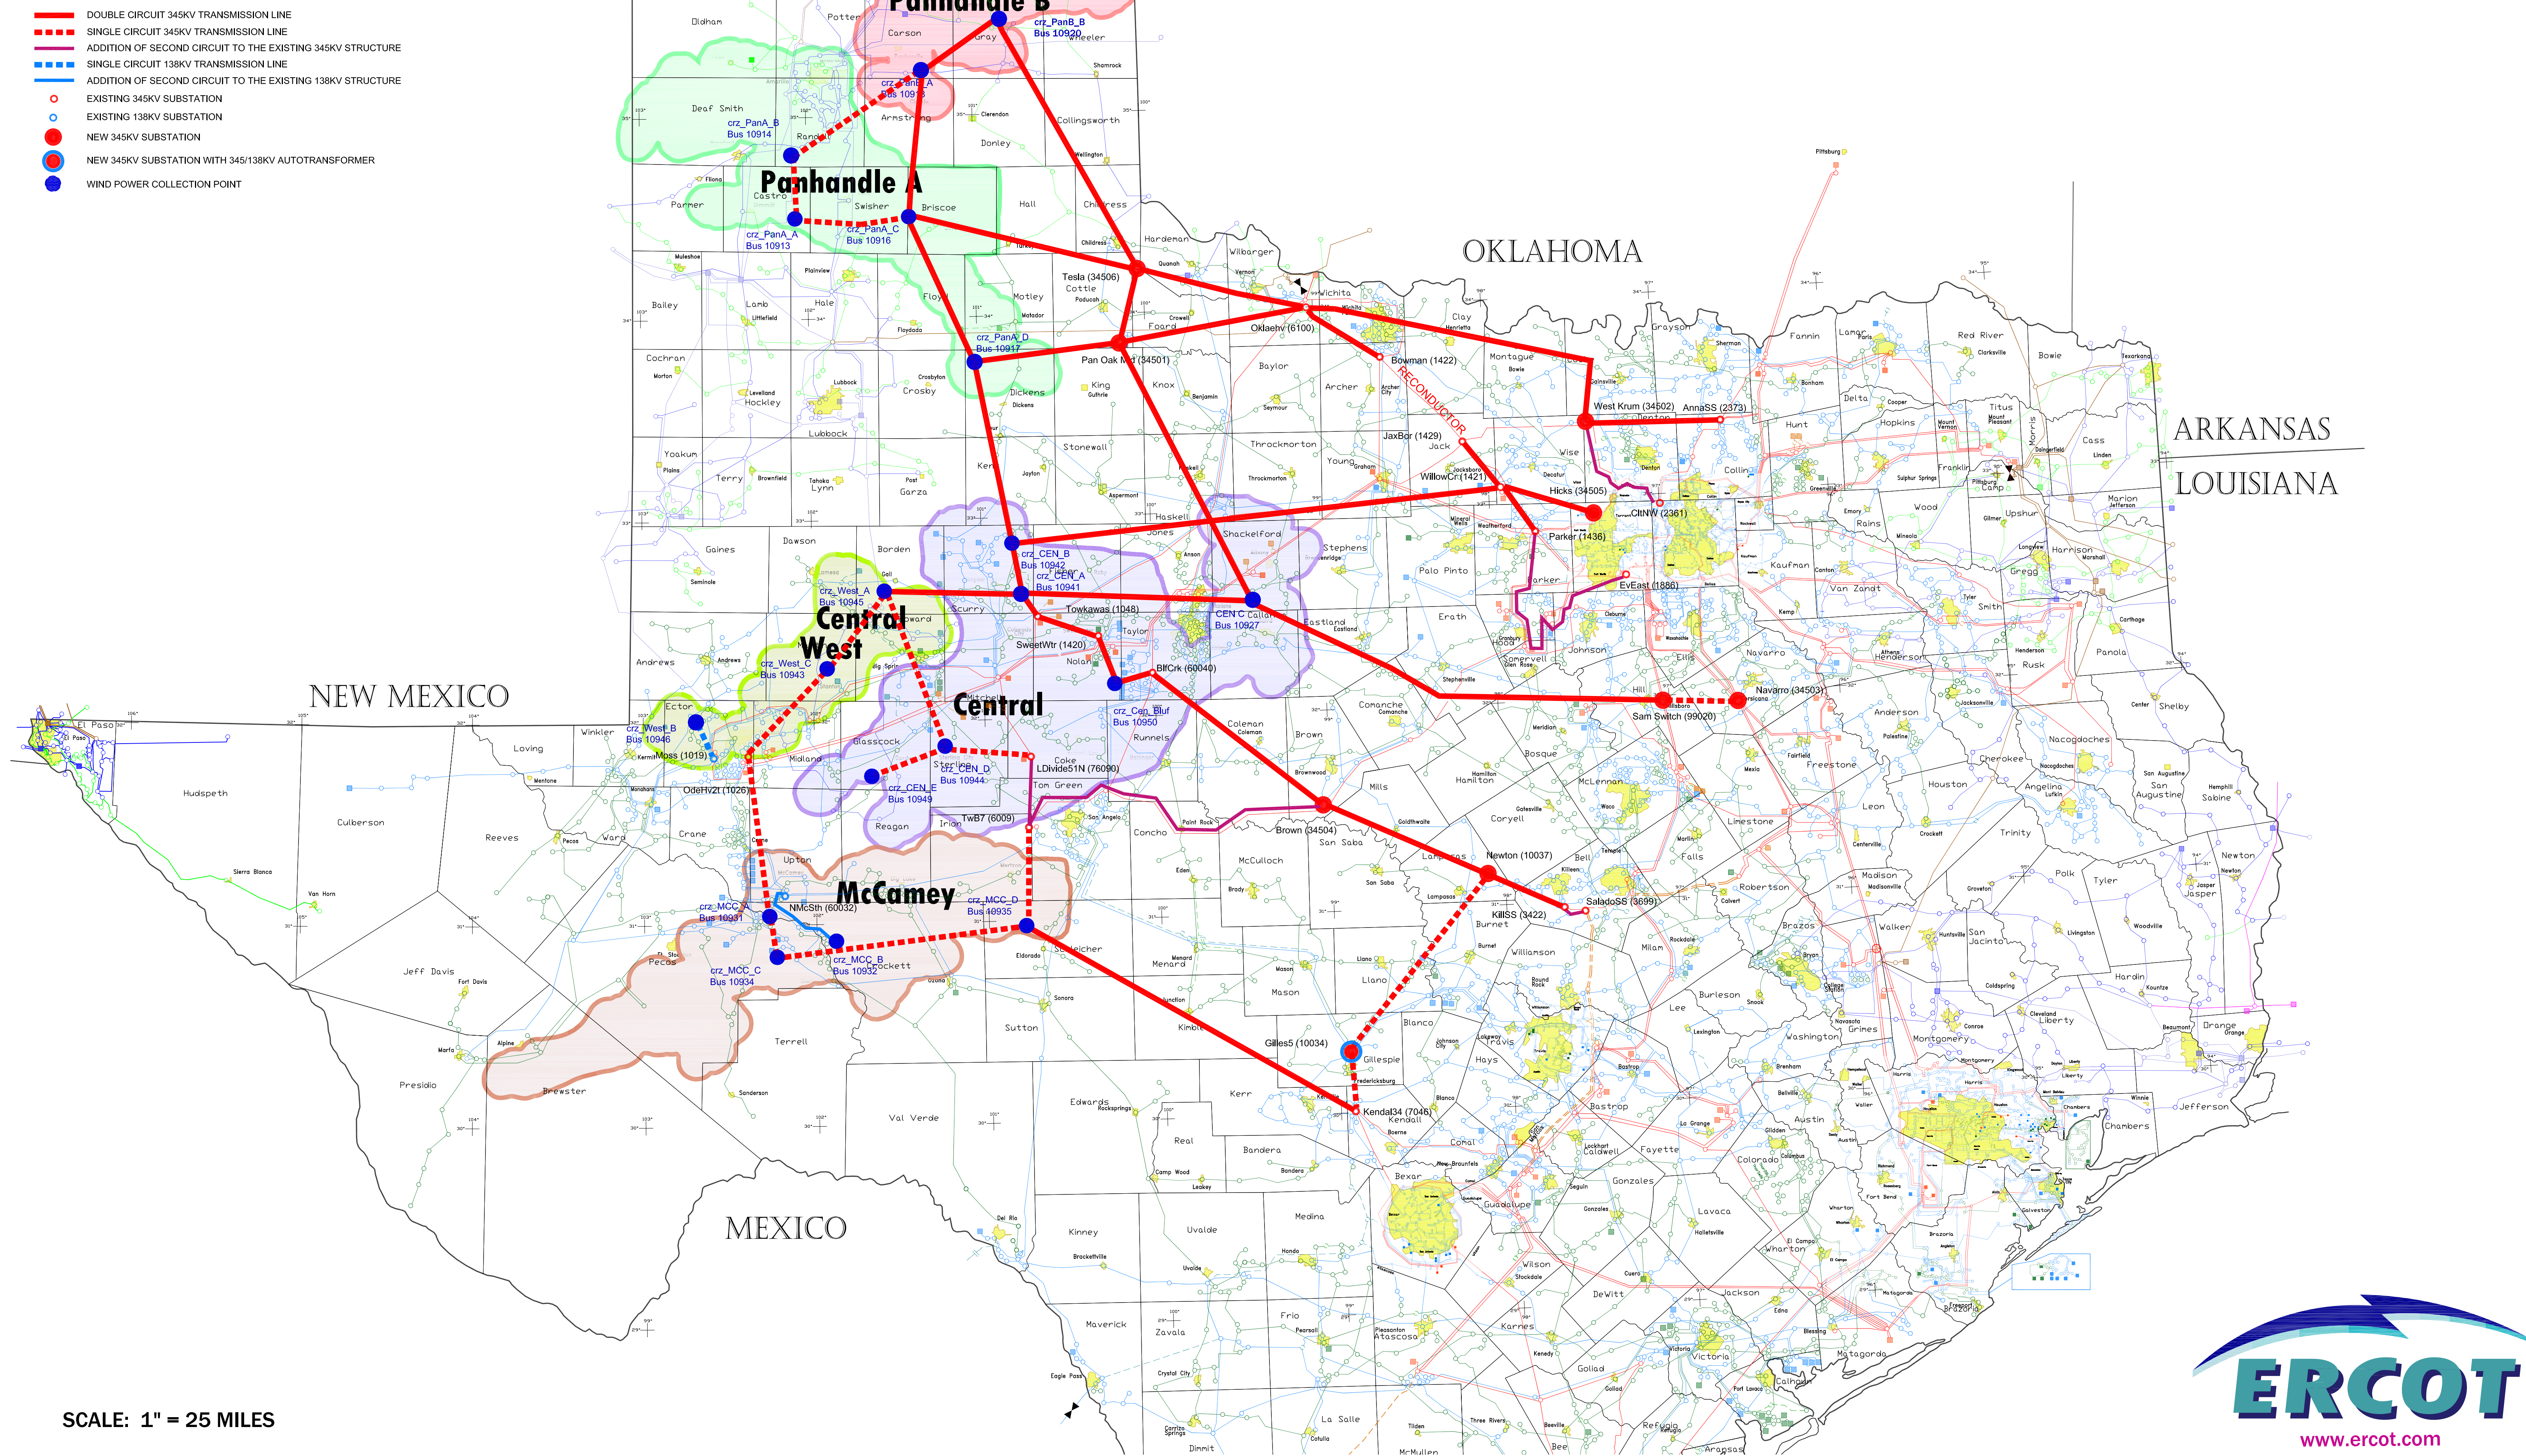